


TANK ALSO TO BE MARKED ON TOP FACE OF LID AND ADJACENT TO INLET WITH:

- "ECONOCYCLE"
- DATE OF MANUFACTURE
- "CAPACITY = 9930L"
- "THE LID IS NOT TO BE LOADED OR COVERED IN ANY WAY OTHER THAN FOR INSPECTION"
- "COMBINED TANK AND LID WEIGHT = 6000kg"

DWV 100mm SNG PVC PIPE
 CHAMBER VOLUME: 9930 L
 CONCRETE VOLUME OF TANK: 1573 L

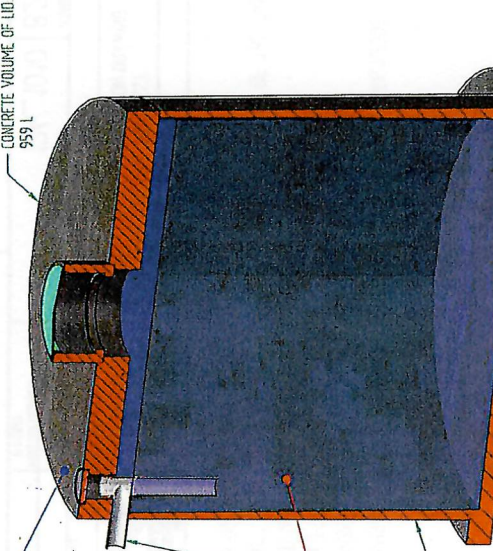

ACCREDITED
 11 AUG 2022
 NSW MINISTRY OF HEALTH

NOTES:
GENERAL
 1. SEPTIC TANKS MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546.1:2008

MARKING
 TANK TO BE MARKED AS NOTED ON THIS DRAWING

CONCRETE:

1. CONCRETE STRENGTH $F_c = 40\text{MPa}$
2. SLUMP = 100mm
3. MAXIMUM AGGREGATE SIZE = 40mm
4. CONCRETE TO BE VIBRATED TO ENSURE THOROUGH COMPACTION
5. TANKS TO BE REINFORCED WITH FIBRE STEEL OF 600MPa MINIMUM TENSILE STRENGTH - OR EQUIVALENT, MIXED TO ACHIEVE A MINIMUM OF 75kg/m³ OF CONCRETE
6. LID TO BE REINFORCED WITH TWO LAYERS OF S172 STEEL MESH 30mm ABOVE THE BOTTOM
7. LARGE LID INSPECTION HOLE TO BE REINFORCED WITH R12 DEFORMED BAR AS SHOWN
8. ALL STEEL REINFORCEMENT TO AS/NZS 4671

ATTACHMENTS:

1. LIFTING HOOKS TO BE 'REID SWIFT' LIFTS 4 x 2.5T (TONNE), ANCHORS TO BE CAST INTO THE BASE OF THE TANK
2. 3 x 13 tonne ANCHORS TO BE CAST INTO THE TANK LIDS

HYDROSTATIC UPLIFT:

1. ANCHORAGE SHALL BE PROVIDED ON TANKS THAT ARE INSTALLED OTHER THAN ABOVE GROUND AND WHEN THEY ARE NOT PERMANENTLY FILLED TO THE FULL HEIGHT SHOWN ON THIS DRAWING.

		DATE PUBLISHED	29/05/2017	CONTRACT NO.	NONE	SHEET NO.	A3
		SCALE	DO NOT SCALE	VERSION	---	SHEET IN.	1 OF 1
		UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN MM		PROJECT: 2540x2350-10000-LW TITLE: 10,000L COLLECTION WELL CERTIFICATION DRAWING			

MASS 5906 kg

SECTION A-A