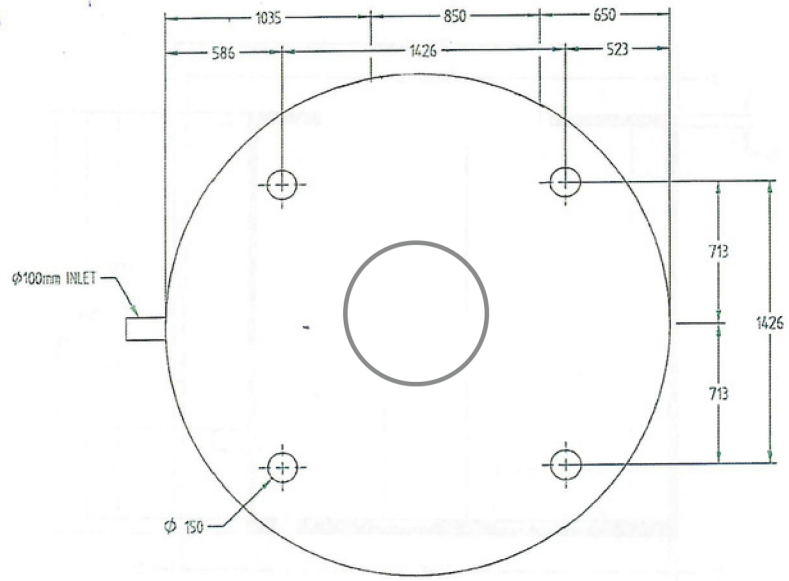

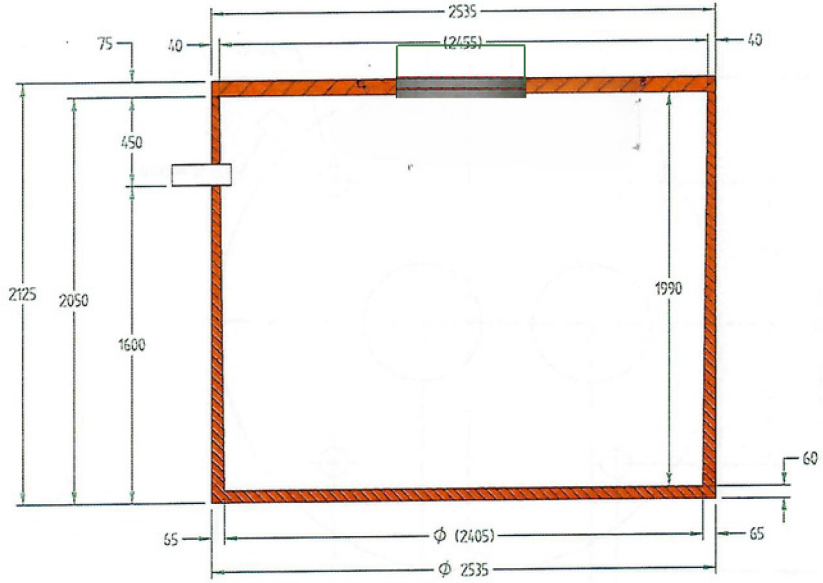

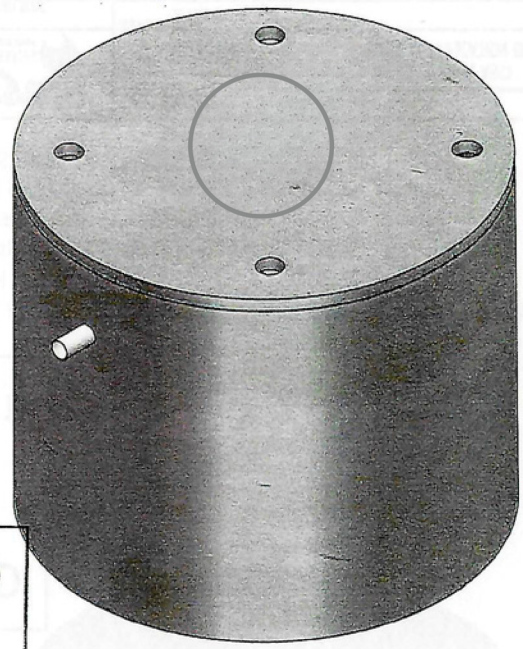

ACCREDITED

11 AUG 2022

NSW MINISTRY OF HEALTH

NOTES:

1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546.1:2008
2. CONCRETE STRENGTH = 40MPa
3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
4. TANKS TO BE REINFORCED WITH FIBRE STEEL
5. LIFTING TO BE "REID SWIFT LIFTS" 4 x 2.5 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK, 3 x 1.3 TONNE ANCHORS CAST INTO TANK LIDS

Econocycle
AERATED WASTEWATER TREATMENT SYSTEMS

COPYRIGHT
THE DRAWING AND INFORMATION CONTAINED WITHIN REMAIN THE COPYRIGHT PROPERTY OF ECONOCYCLE AND CANNOT BE COPIED OR REPRODUCED WITHOUT WRITTEN PERMISSION

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN MM

SCALE	DO NOT SCALE
DRAWN BY	P MCKAY
MODELLED BY	P MCKAY
DATE PLOTTED	27/07/2010
DRAWING LAST MODIFIED BY	P MCKAY
MODEL LAST MODIFIED BY	P MCKAY
PROJECT	COLLECTION WELL
TITLE	7000L CONCRETE TANK ASSY NSW HEALTH CERTIFICATION DRAWING
CONT/TREAT.	-
PART#	124_0910
REVISION	1.D
SHEET SIZE	A3
SHEET No.	1 OF 1